

ADA Compliance Program

Clark County Facilities Transition Plan

Law Enforcement Center

Date of Survey: July 10, 2006

Conducted by: Clark County Citizen ADA Advisory Committee

Wayne Yarnall




Bud Van Cleve




Teresa Guise (Absent)

Connie Brittain

Jesse Magana

Tim McVicker

	<p>Item # 1</p> <p>Issue: Bicycle Locker Obstructs pedestrian crosswalk threshold</p> <p>Issue:</p> <p>Location: South side of Public Service Center</p> <p>Code:</p> <p>Notes: Bicycle locker blocks pedestrian crosswalk between the Public Service Center and Law Enforcement Center/Courthouse</p>
	<p>Item # 2</p> <p>Issue: No detectable warnings on Two Curb Cuts for Disabled Parking Access Aisles.</p> <p>Issue:</p> <p>Location: SE Corner of north parking lot</p> <p>Code: IBC- Section 1102 Definitions – Detectable Warnings – A standardized surface feature built in or applied to walking surfaces or other elements to warn visually impaired persons of hazards on a circulation path. ANSI Code: 705.2 Standardization – Detectable warning surfaces shall be standard within a building, facility, site or complex of buildings ANSI 705.5 Truncated Domes – Detectable warning surfaces shall have truncated domes complying with Section 705.5</p> <p>Notes:</p>
	<p>Item # 3</p> <p>Issue: Signage – North entrance is inaccessible. Signage is required with directions to nearest accessible entrance to the east.</p> <p>Issue:</p> <p>Location: North Entrance</p> <p>Code: IBC 1110.1 - Signs Required Accessible elements shall be identified by the International Symbol of Accessibility at the following locations: – Accessible entrances where not all entrances are accessible. IBC 1110.2 - Directional Signage Directional signage indicating the route to the nearest like</p>

	<p>accessible element shall be provided at the following locations. These directional signs shall include the International Symbol of Accessibility:</p> <ul style="list-style-type: none"> • Inaccessible building entrances
	<p>Item # 4</p> <p>Issue: Curb Cuts</p> <p>Issue:</p> <p>Location: North parking lot of Law Enforcement Center</p> <p>Code: Curb cuts and detectible warnings should be considered for islands in the north parking lot. This would facilitate direct access to the front of the Law Enforcement Center from the sidewalk. However, accessible routes do exist on the west and east sides of the parking lot.</p> <p>Notes:</p>
	<p>Item # 5</p> <p>Issue: Signage – West entrances are inaccessible. Signage is required with directions to nearest accessible entrance to the east.</p> <p>Issue:</p> <p>Location: West Entrances</p> <p>Code: IBC 1110.1 - Signs Required Accessible elements shall be identified by the International Symbol of Accessibility at the following locations:</p> <ul style="list-style-type: none"> – Accessible entrances where not all entrances are accessible. <p>IBC 1110.2 - Directional Signage Directional signage indicating the route to the nearest like accessible element shall be provided at the following locations. These directional signs shall include the International Symbol of Accessibility:</p> <ul style="list-style-type: none"> • Inaccessible building entrances <p>Notes:</p>
	<p>Item # 6</p> <p>Issue: Stability and Surface – Vertical distance exceeds ½ inch. Requirements: Surface Maintenance</p> <p>Issue:</p> <p>Location: West Sidewalk</p> <p>Code: ANSI 302.1 – General Floor surfaces shall be stable, firm and slip resistant. ANSI 303.3 Beveled Changes in level greater than ¼ inch in height and not more than ½ inch maximum in height shall be beveled with a slope not steeper than 1:2.</p> <p>Notes:</p>



Item # 7
 Issue: No Detectible Warnings
 Issue:
 Location: West Sidewalk at Driveway Crossing
 Code: IBC- Section 1102 Definitions – Detectable Warnings – A standardized surface feature built in or applied to walking surfaces or other elements to warn visually impaired persons of hazards on a circulation path.
 ANSI Code: 705.2 Standardization – Detectable warning surfaces shall be standard within a building, facility, site or complex of buildings
 ANSI 705.5 Truncated Domes – Detectable warning surfaces shall have truncated domes complying with Section 705.5

Notes:







Item # 8
 Issue: Curb Cuts and No Detectible Warnings
 Issue:
 Location: Pedestrian Crosswalks – 11th and Harney
 Code: ANSI 406.1 General - Curb Ramps
 Curb ramps on accessible routes shall comply with Sections 406, 405.2, 405.3 and 405.10.
 IBC- Section 1102 Definitions – Detectable Warnings – A standardized surface feature built in or applied to walking surfaces or other elements to warn visually impaired persons of hazards on a circulation path.
 ANSI Code: 705.2 Standardization – Detectable warning surfaces shall be standard within a building, facility, site or complex of buildings
 ANSI 705.5 Truncated Domes – Detectable warning surfaces shall have truncated domes complying with Section 705.5 (See preceding photo and comments)

Notes:



Item # 9
 Issue: No Detectible Warnings
 Issue:
 Location: South Sidewalk at Driveway Crossing
 Code: IBC- Section 1102 Definitions – Detectable Warnings – A standardized surface feature built in or applied to walking surfaces or other elements to warn visually impaired persons of hazards on a circulation path.
 ANSI Code: 705.2 Standardization – Detectable warning surfaces shall be standard within a building, facility, site or complex of buildings
 ANSI 705.5 Truncated Domes – Detectable warning surfaces shall have truncated domes complying with Section 705.5

Notes:

	<p>Item # 10</p> <p>Issue: Stability and Surface</p> <p>Issue:</p> <p>Location: South Sidewalk Deterioration</p> <p>Code: ANSI 302.1 – General Floor surfaces shall be stable, firm and slip resistant.</p> <p>Notes:</p>
	<p>Item # 11</p> <p>Issue: No Detectible Warnings</p> <p>Issue:</p> <p>Location: 11th and Grant</p> <p>Code: IBC- Section 1102 Definitions – Detectable Warnings – A standardized surface feature built in or applied to walking surfaces or other elements to warn visually impaired persons of hazards on a circulation path. ANSI Code: 705.2 Standardization – Detectable warning surfaces shall be standard within a building, facility, site or complex of buildings ANSI 705.5 Truncated Domes – Detectable warning surfaces shall have truncated domes complying with Section 705.5</p> <p>Notes:</p>
	<p>Item # 12</p> <p>Issue: No Detectible Warnings</p> <p>Issue:</p> <p>Location: SW Corner of Building – Juror Parking Lot Crosswalk to Courthouse</p> <p>Code: IBC- Section 1102 Definitions – Detectable Warnings – A standardized surface feature built in or applied to walking surfaces or other elements to warn visually impaired persons of hazards on a circulation path. ANSI Code: 705.2 Standardization – Detectable warning surfaces shall be standard within a building, facility, site or complex of buildings ANSI 705.5 Truncated Domes – Detectable warning surfaces shall have truncated domes complying with Section 705.5</p> <p>Notes:</p>
	<p>Item # 13</p> <p>Issue: Stability and Surface</p> <p>Issue:</p> <p>Location: NW End of Crosswalk from Juror Parking Lot to Courthouse</p> <p>Code: ANSI 302.1 – General Floor surfaces shall be stable, firm and slip resistant. ANSI 303.3 Beveled Changes in level greater than ¼ inch in height and not more than ½ inch maximum in height shall be beveled with a slope not steeper than 1:2.</p> <p>Notes: Vertical distance is almost 2 inches</p>



Item # 14 - Curb Cuts and Accessible Route
 Item # 15 - Detectible Warnings
 Item # 16 - Van Accessible Parking
 Issue: See above
 Issue:
 Location: SE Corner of Building – Disabled Parking Area on Grant Street
 Code: ANSI 502.4.1 Location – Access aisles shall adjoin an accessible route.
 IBC- Section 1102 Definitions – Detectable Warnings – A standardized surface feature built in or applied to walking surfaces or other elements to warn visually impaired persons of hazards on a circulation path.
 ANSI Code: 705.2 Standardization – Detectable warning surfaces shall be standard within a building, facility, site or complex of buildings
 ANSI 705.5 Truncated Domes – Detectable warning surfaces shall have truncated domes complying with Section 705.5
 IBC 1106.5 Van Spaces – For every six or fraction of six accessible spaces, at least one shall be a van accessible space. (There are no van accessible spaces on the south side of the Law Enforcement Center or Courthouse)
 ANSI 502.2 - See ANSI Chapter 5 for placement and size of accessible parking spaces to include van spaces requirements.



Item # 17
 Issue: No Vertical Disabled Parking Signage in Juror Parking Lot
 Issue:
 Location: South Juror Parking Lot
 Code: RCW 46.61.581 Parking Spaces for Persons with Disabilities
 A parking space or stall for a person with a disability shall be indicated by a vertical sign with the international symbol of access, whose colors are white on a blue background, described under RCW 70.92.120.
 Notes:



Item # 18
 Issue: Ramp Slope
 Issue:
 Location: Lower Portion of Ramp to Ground Floor of Law Enforcement Center
 Code: Ramps shall have a Running Slope not Steeper than 1:12.
 ANSI 405.2 Slope – Ramp runs shall have a running slope not steeper than 1"12.
 Exception: In existing buildings or facilities ramps shall be permitted to have slopes steeper than 1:12 complying with 405.2 where such slopes are necessary due to space limitations.
 Notes:



Item # 19

Issue: Accessible Entrance Signage

Issue:


Location: Lower Entrance to Ground Floor of Law Enforcement Center

Code: RCW 70.92.120 Handicap Symbol – Display – Signs Showing Location Entrance for Handicapped.

All buildings built in accordance with the standards and specifications provided for in this chapter, and containing facilities that are in compliance therewith, shall display the following symbol which is known as the International Symbol of Access.

Such symbol shall be white on a blue background and shall indicate the location of facilities designed for the physically disabled or elderly. When a building contains an entrance other than the main entrance which is ramped or level for use by physically disabled or elderly persons, a sign with the symbol showing its location shall be posted at or near the main entrance which shall be visible from the adjacent public sidewalk or way.

Notes:

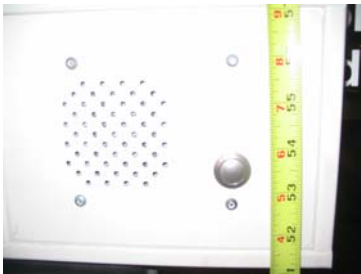

Item # 20

Issue: Call Button Height

Issue:


Location: Lower Entrance to Ground Floor of Law Enforcement Center

Code: ANSI 308.2 Forward Reach

ANSI 308.3.1 Side Reach – Unobstructed

Both of the noted ANSI requirements have a maximum high reach shall be 48 inches.

Notes: Reach Range The call button height is 53.5"

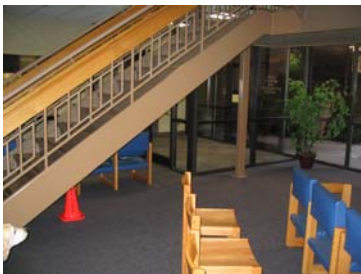

Item # 21

Issue: Stairs – Protrusion Limits

Issue:

Location: Ground Floor of Law Enforcement Center

Code: ANSI 307.4 Reduced Vertical Clearance

Guardrails or other barriers shall be provided where object protrusion is beyond limits allowed by Sections 307.2 and 307.3, and where the vertical clearance is less than 80 inches above the floor. The leading edge of the guardrail or barrier shall be 27 inches maximum above the floor.

Notes: Recommendations:

- Construct Barrier
- Position furniture to block access to area under stairwell.

Note: The Sheriff's Office normally has chairs blocking access to the underside of the stairwell as noted on the far side of the staircase in this photo. At the time this photo was taken, the chairs had been moved for an awards ceremony.



Item # 22 – Public Telephone Height of Operable Parts
 Item # 23 – Public Telephone - Length of Cord
 Issue:
 Issue:
 Location: 1st Floor of Law Enforcement Center
 Code: ANSI 704.2.2 Operable Parts (Telephone) The highest operable part of the telephone shall comply with Section 308. (48")
 ANSI 704.2.4 Cord Length. The telephone handset cord shall be 29 inches minimum in length
 Notes: The Telephone on the 1st floor lobby of the Law Enforcement Center is too high. The coin deposit height is 59.5" and the cord length is 28".

No Photo





Item # 24
 Issue: Knee Clearance
 Issue:
 Location: Sex Offender Citizen Computer table – 1st Floor of Law Enforcement Center
 Code: ANSI 306.3.3 Where knee clearance is required beneath an element as part of a clear floor space, the knee clearance shall be part 11 inches minimum in depth at 9 inches above the floor, and 8 inches minimum in depth at 27 inches above the floor
 Notes: The knee clearance height of the sex offender computer information table is 24.75" high.






Item # 25
 Issue: Maneuvering Clearances
 Issue:
 Location: Public Men's Restroom – 1st Floor of Law Enforcement Center
 Code: Minimum Maneuvering Clearances
 The door clearance in the men's restroom is 14 inches. A power door is recommended as clearance is very tight for someone in a wheelchair.
 ANSI 404.2.2 Clear Width of Doorways

TYPE OF USE		MINIMUM MANEUVERING CLEARANCES	
Approach Direction	Door Side	Perpendicular to Door	Parallel to Doorway (beyond latch unless noted)
From front	Pull	60 inches	18 inches

Notes:

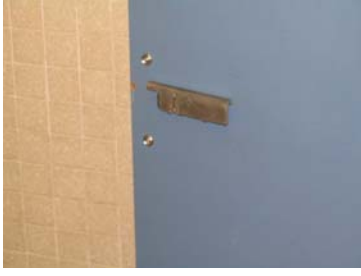	<p>Item # 26</p> <p>Issue: Exposed Pipes</p> <p>Issue:</p> <p>Location: Public Men's and Women's Restroom – 1st Floor of Law Enforcement Center</p> <p>Code: ANSI 606.6 Exposed Pipes and Surfaces – Water supply drainpipes under lavatories and sinks shall be insulated or otherwise configured to protect against contact. There shall be no sharp or abrasive surfaces under lavatories and sinks.</p> <p>Notes:</p>
	<p>Item # 27</p> <p>Issue: Flush Handle Location</p> <p>Issue:</p> <p>Location: Public Men's Restroom – 1st Floor of Law Enforcement Center</p> <p>Code: ANSI – Flush Controls – Hand operated flush controls shall be located on the open side of the water closet.</p> <p>Notes: Requirement: Hand operated flush controls shall be located on the open side of the water closet.</p>
	<p>Item # 28</p> <p>Issue: Toilet Paper Dispenser</p> <p>Issue:</p> <p>Location: Public Men's Restroom – 1st Floor of Law Enforcement Center</p> <p>Code: ANSI 604.7 Dispensers – Toilet paper dispensers shall comply with Section 3098.4 and shall be 7 inches minimum and 9 inches maximum in front of the water closet measured to the centerline of the dispenser. The outlet of the dispenser shall be 15 inches minimum and 48 inches maximum above the floor and shall not be located behind grab bars. ANSI 308.3.2 Reach range should be between 10" and 24".</p> <p>Notes:</p>
	<p>Item # 29</p> <p>Issue: Coat Hook Height</p> <p>Issue:</p> <p>Location: Public Men's Restroom – 1st Floor of Law Enforcement Center</p> <p>Code: Requirement: Hooks and Shelves not to Exceed 40 inches Hook in men's restroom accessible stall is 68 inches high. ANSI – Coat Hooks and Shelves Coat hooks and shelves shall be located within one of the reach ranges specified in Section 308. Shelves shall be 40 inches minimum and 48 inches maximum above the floor.</p> <p>Notes:</p>

	<p>Item # 30</p> <p>Issue: Accessible Stall Door Lock</p> <p>Issue:</p> <p>Location: Public Men's Restroom – 1st Floor of Law Enforcement Center</p> <p>Code: Requirement: Door handle is broken and needs to be repaired. Handles must be able to be operated with a closed fist. This handle meets that requirement but must be repaired.</p> <p>Notes:</p>
	<p>Item # 31</p> <p>Issue: Towel Dispenser Height</p> <p>Issue:</p> <p>Location: Public Men's and Women's Restroom – 1st Floor of Law Enforcement Center</p> <p>Code: Requirement: Height Maximums The height of the towel dispensers in the men's and women's restrooms is 58 inches to the paper dispenser. ANSI 308.2 Forward Reach ANSI 308.3.1 Side Reach – Unobstructed Both of the noted ANSI requirements have a maximum high reach shall be 48 inches.</p> <p>Notes:</p>
	<p>Item # 32</p> <p>Issue: Signage</p> <p>Issue:</p> <p>Location: Restroom – 1st Floor of Law Enforcement Center</p> <p>Code: Requirement: Location and Detail The current signs are improperly placed and lack Braille. ANSI 703.1 – General - Accessible signs shall comply with Section 703. (Check for character height etc.) ANSI 703.3.11 Location – Where a tactile sign is provided at a door, the sign shall be alongside the door at the latch side. ANSI 703.4.1 General – Braille shall be contracted Braille and shall comply with Section 703.4.</p> <p>Notes:</p>



Item # 33

Issue: Call Button Height

Issue:

Location: Door to Work Release and Main Control 1st Floor of Law Enforcement Center

Code: Requirement: Reach Range The call button height is for Work Release is 57.5" – call button height for Main Control is 60 inches.
ANSI 308.2 Forward Reach
ANSI 308.3.1 Side Reach – Unobstructed
Both of the noted ANSI requirements have a maximum high reach shall be 48 inches.

Notes:



Item # 34 - Floor Identification Lacks Braille

Item # 35 - Audible Signals

Issue: See Above

Issue:

Location: Elevator to Community Corrections - 1st Floor of Law Enforcement Center

Code: Requirements: ANSI 407.2.3.1
ANSI 407.2.3.1 Floor designators shall be provided in tactile characters complying with section 70.3 located on both jambs of elevator hoistway entrances (ANSI 407.2.3.2 with Braille)
ANSI 407.2.2.3 Audible signals shall sound once for the up directions and twice for the down direction.

Notes: