



ADA Compliance Program

Clark County Facilities Transition Plan Clark County Center for Community Health – 3rd and 4th Floors

Date of Survey: May 8, 2006

Conducted by:

- Teresa Guise
- Vern Perry
- Tim McVicker



Typical installation of all drinking fountains on 3rd floor and throughout the building.

Item: Drinking Fountain – 3rd Floor Lobby


ANSI 307.2 Protrusion Limits.

Objects with leading edges more than 27 inches and not more than 80 inches above the floor shall protrude 4 inches maximum horizontally into the circulation path.

The drinking fountain shown protrudes 11 inches and the height shown is 32 3/8 inches.

Recommendations:

- Fountains should be recessed into an alcove.
- Barrier's constructed around fountains

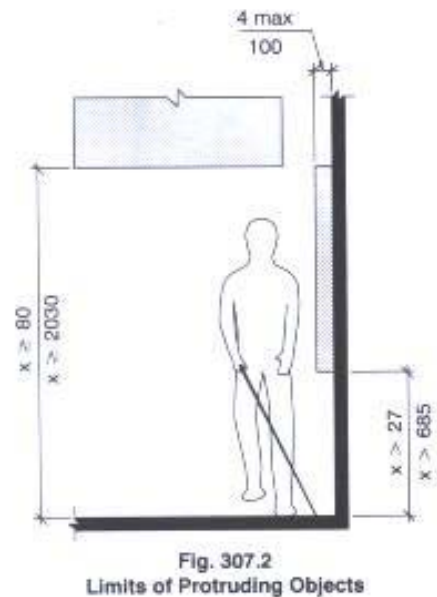

Item : Pipe Covering

Location: Break Room – 3rd Floor – Rooms 333 and 345

ANSI Section – 606.6 Exposed Pipes and Surfaces

Water supply and drainpipes under lavatories and sinks shall be insulated or otherwise configured to protect against contact. There shall be no sharp or abrasive surfaces under lavatories and sinks.

Recommendation:

- Insult or pad exposed pipe