



# Americans with Disabilities Office General Services Department

## Accessibility Survey

**Date: December 1, 2009**

**Location: Sheriff's Property/Logistics Warehouse**


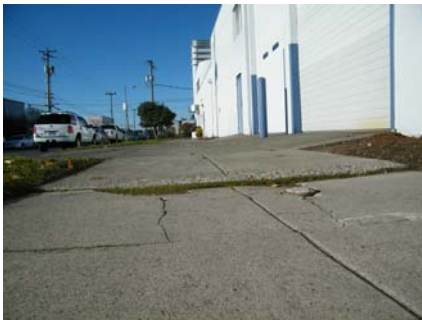
**Survey Team:**

Wayne Yarnall  
 Trenton Hanson

Jesse Magana  
 Dave Maret

Laura Pedersen  
 Tim McVicker

**Observations:**

Photo Orientation	Code - Remarks
	<p>Item #            1</p> <p>Issue:            Landing</p> <p>Issue:</p> <p>Location:        South (Main Public) Entrance to Property Warehouse</p> <p>Code:            ANSI A117.1-2003 - Section 405.7.3 Length – Landings shall have a clear length of 60 inches minimum.</p> <p>Notes:           Construction of a ramp is not possible as it would protrude into the sidewalk. The proposed solution for public access is to install a wireless buzzer accessible from the sidewalk which when activated will be answered by Property Unit staff. Staff would then assist the individual requesting service.</p>
	<p>Item #            2</p> <p>Issue:            Surface Maintenance - Stability and Surface – Vertical distance exceeds ½ inch.</p> <p>Issue:</p> <p>Location:        South Sidewalk – Property Warehouse</p> <p>Code:            ANSI 303.3 Beveled Changes in level greater than ¼ inch in height and not more than ½ inch maximum in height shall be beveled with a slope not steeper than 1:2.</p> <p>Notes:           Floor surfaces shall be stable, firm and slip resistant.</p>