




Clark County Building Safety Division

Two One - Hour Townhouse Walls

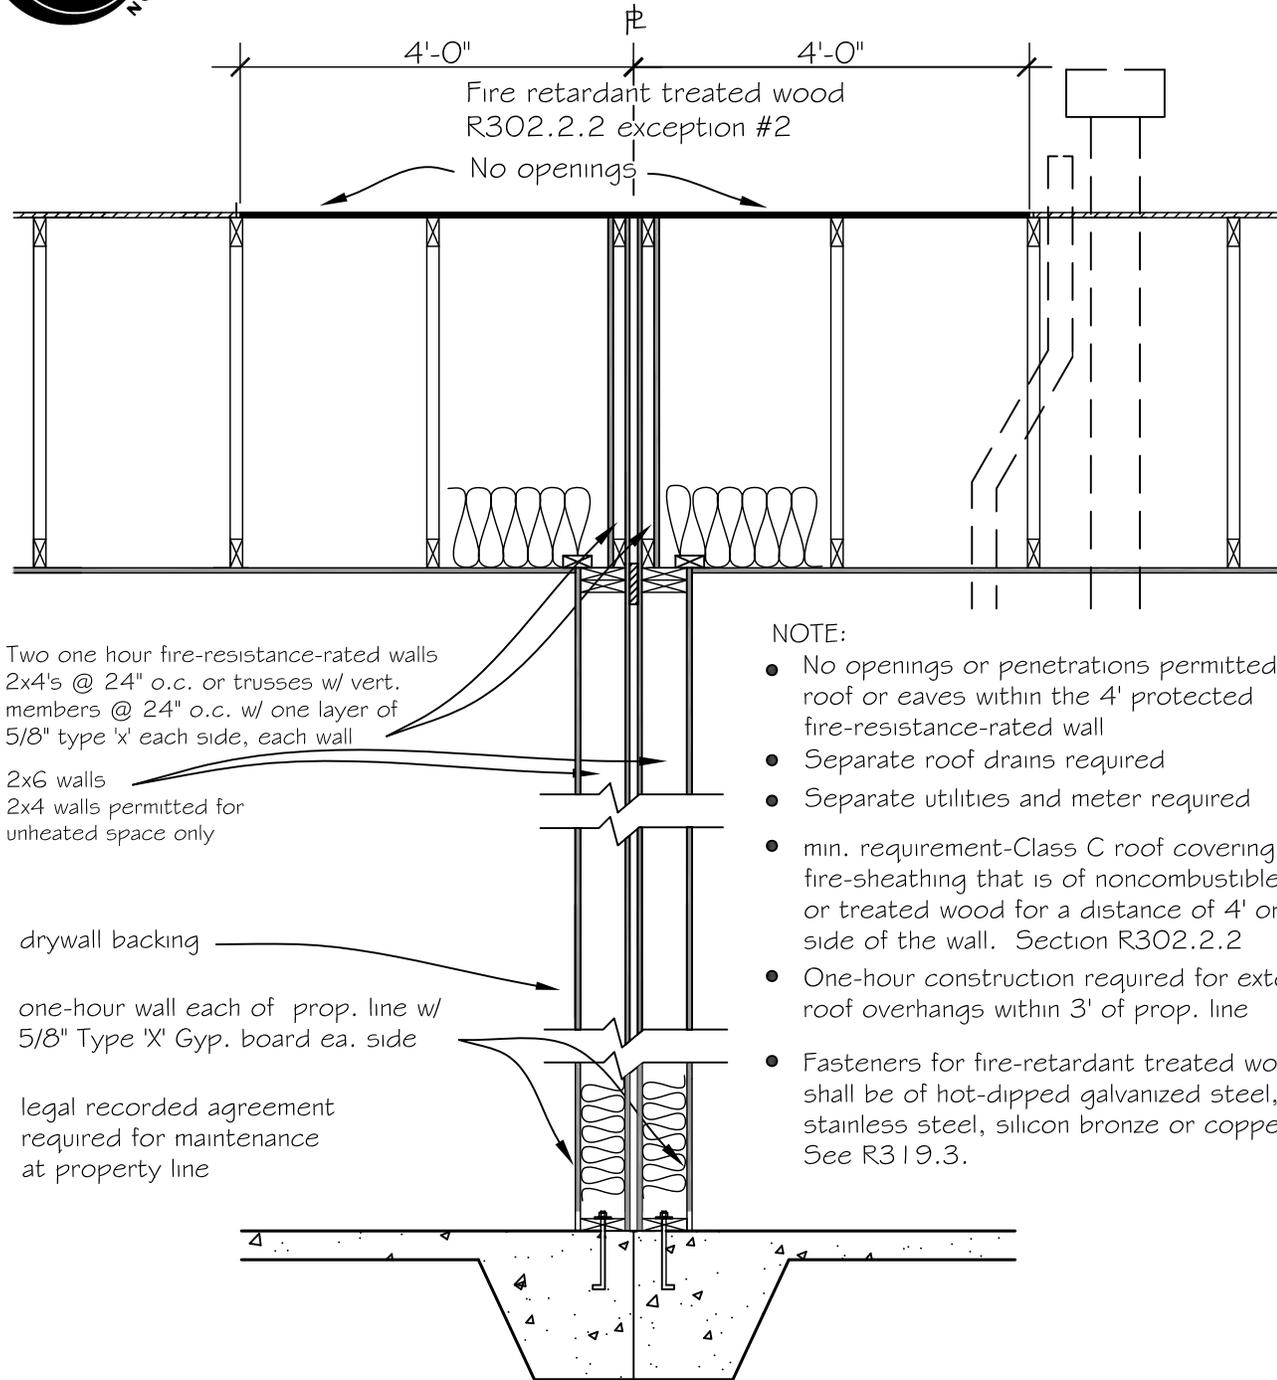

"Through penetrations shall be protected by an approved penetration firestop system installed as tested in accordance with ASTM E 814 or UL 1479. Penetrations shall have an "F" rating of not less than the required fire-resistance rating of the wall or floor-ceiling assembly penetrated".

Please provide the manufactures installation spec sheets for the **approved penetration firestop system's** being used on the project for both the plan review process and onsite for field inspections.

CONDITION SHOWN WITH RAFTERS OR TRUSSES PARALLEL TO FIRE-RESISTANCE-RATED WALL
SECTION R302.2.2 (Exception)-NO PARAPET REQUIRED WHEN BUILDING IS PROTECTED 4
FEET EACH SIDE OF FIRE WALL W/FIRE RETARDANT-TREATED WOOD