



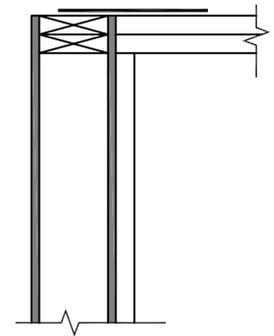


Clark County Building Safety Division

Two One - Hour Townhouse Walls 0-3'-0"

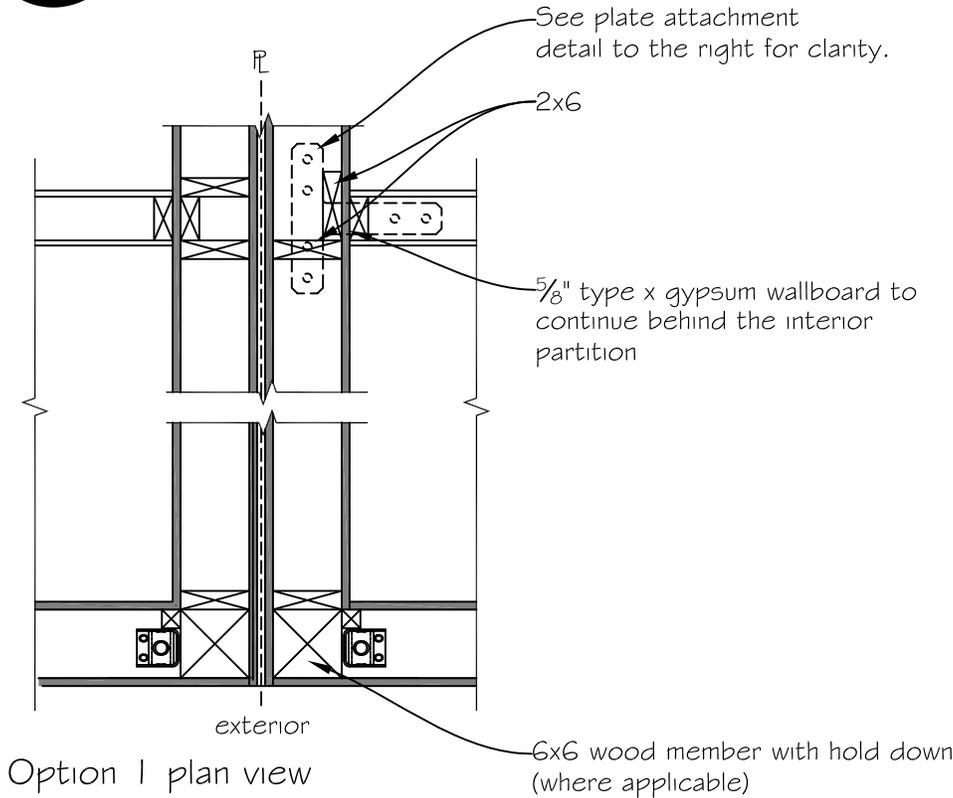


Elevation



Plan view

Plate Attachments

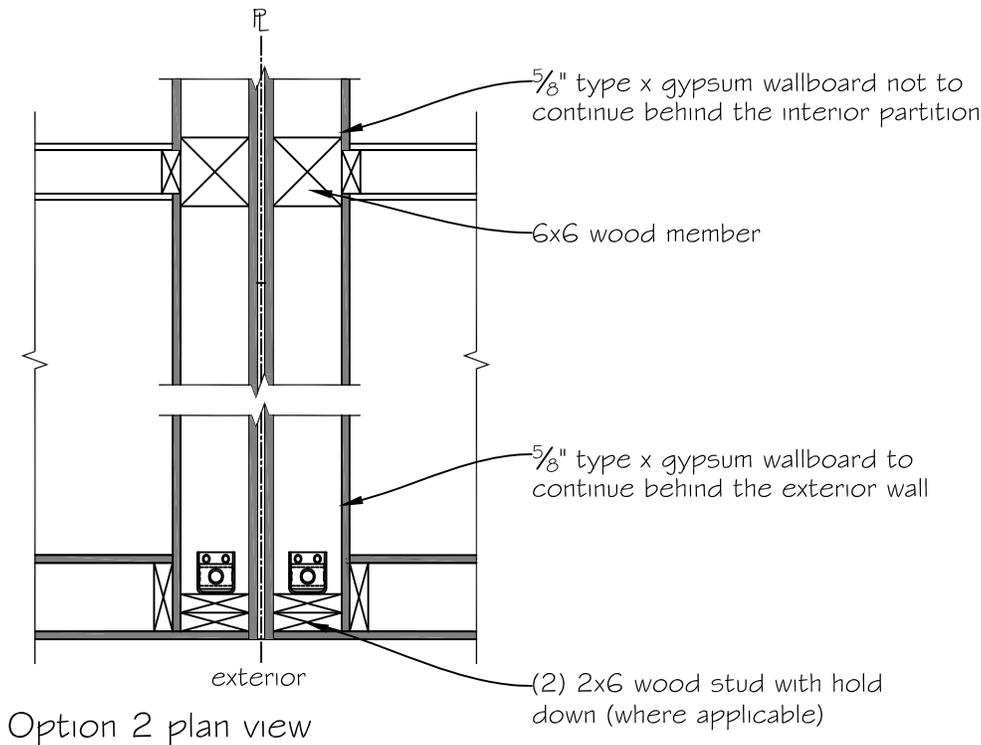

"Through penetrations shall be protected by an approved penetration firestop system installed as tested in accordance with ASTM E 814 or UL 1479. Penetrations shall have an "F" rating of not less than the required fire-resistance rating of the wall or floor-ceiling assembly penetrated".

Please provide the manufacturers installation spec sheets for the **approved penetration firestop system's** being used on the project for both the plan review process and onsite for field inspections.