




# Clark County Building Safety Division


2015 IRC/WAC R302.13 Fire protection of floor assemblies required when using manufacturer joist or or sawn cut lumber less than 2x10 if under floor space is used as storage or has fuel fired appliances.

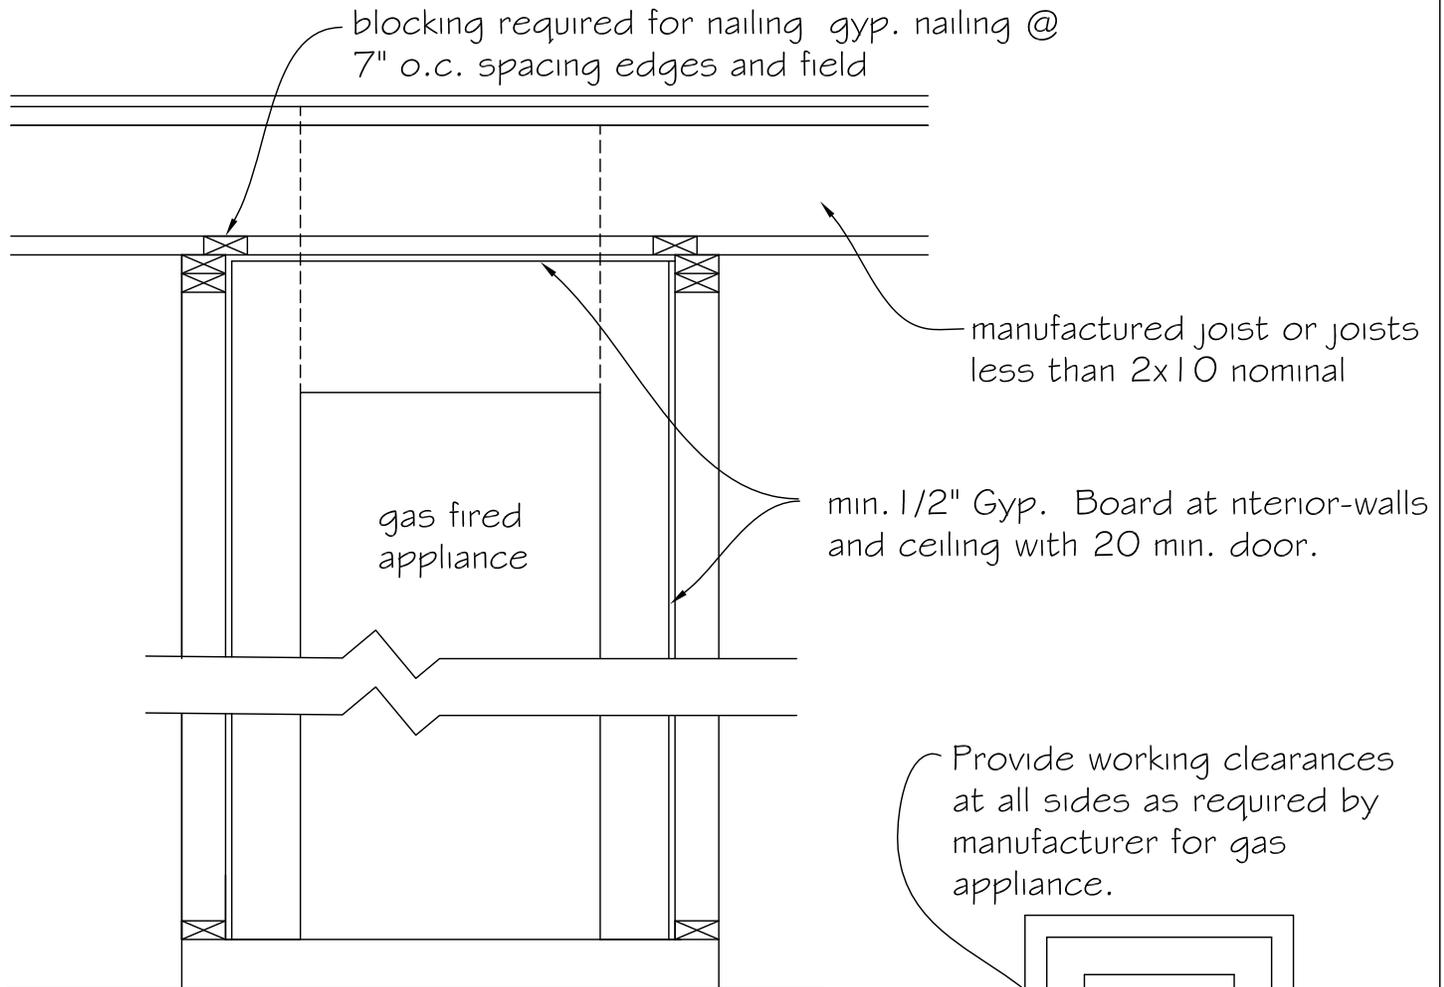

## Section

This detail provides an exception to the fire protection requirement of engineered wood floor joist when using under floor space for fuel fired appliances or storage.

Provide working clearances at all sides as required by manufacturer for gas appliance.

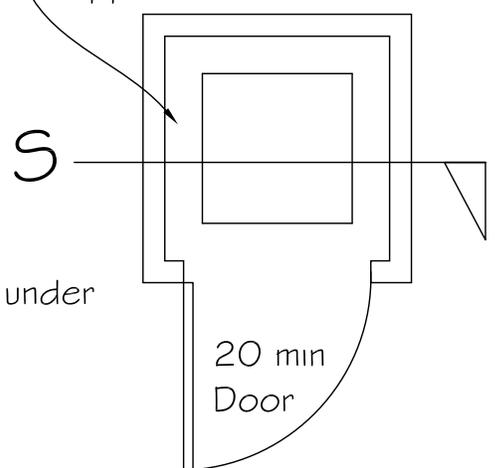

## Plan