


SECTION A-A

\*NOTE:  
SWALE DESIGN REQUIRES A MINIMUM OF 9 MINUTES OF RESIDENCE TIME ( $n=0.20$ ).

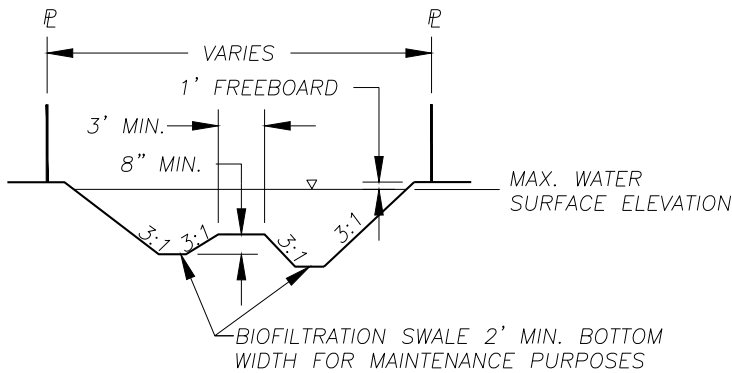

SECTION B-B

NOTES:

1. THE DESIGN OF THE STORMWATER FACILITIES SHALL MEET THE DESIGN STANDARD AS SET FORTH IN CCC 40.386 AND CCSWM.
2. THIS DETAIL IS AN EXAMPLE STORMWATER FACILITY FOR URBAN INFILL. EACH SWALE NEEDS TO BE ENGINEERED TO SITE SPECIFIC CONDITIONS AND ELEVATIONS.
3. SEE STANDARD SWALE SECTIONS, AND FLOW SPREADER DETAILS.

NO.	REVISIONS	DATE	BY

DWG: D11.0.DWG



Department of  
Public Works  
**CLARK COUNTY**  
WASHINGTON  
proud past, promising future

EXAMPLE STORMWATER FACILITY  
FOR URBAN INFILL DEVELOPMENT

APPROVED  
*[Signature]*  
COUNTY ENGINEER

01/07/16  
DATE

STANDARD  
**D11.0**  
DETAIL  
DESIGNED  
DRAWN  
DATE 01/30/15